



**Guilford County
Environmental Health Division
Water Quality Section
400 W. Market Street
Greensboro, NC 27401
336.641.7613**



Operation Permit

Address: 7683 Anthony RD, Kernersville, NC 27284

Permit Number: 21-08-SNHR-06915

Contractor:

MEREDITH GLEN SEPTIC TANK CO

Filter Type	Polylock	Product Name	Chamber
Septic Tank Size	GAL1000	System Type	2a - Conventional
Septic Tank Type	HPPP-1000, STB-156	Trench Length	480 FT
		Trench Width	36 IN
		Wastewater Flow	360 GPD

Comments:


Glenn Meredith set new 1000gal septic tank HPPP-1000, STB-156 (4/17/22) with a Polylok filter and 4' of 4" sch40 PVC supply line out of the tank and into 364' of IQ4P chambers in 6 lines.

Drainfield Approval:	<u>KCM</u>	Date:	<u>6/9/22</u>
	Environmental Health Specialist		
Tank Approval:	<u>KCM</u>	Date:	<u>6/9/22</u>
	Environmental Health Specialist		
Supply Line Approval:	<u>KCM</u>	Date:	<u>6/9/22</u>
	Environmental Health Specialist		
Pump/Alarm Approval:	-----	Date:	_____
	Environmental Health Specialist		
Operational Permit Approval:	<u>Kenneth C Melder RCHS</u>	Date:	<u>7/6/22</u>
	Environmental Health Specialist		


This System is in compliance with Article 11 of G.S. Chapter 130A .1900 "Sewage Treatment and Disposal Systems" and all conditions prescribed by the Authorization for Wastewater System Construction. This Operation Permit is subject to suspension or revocation if the stated conditions are not met.



Diagram

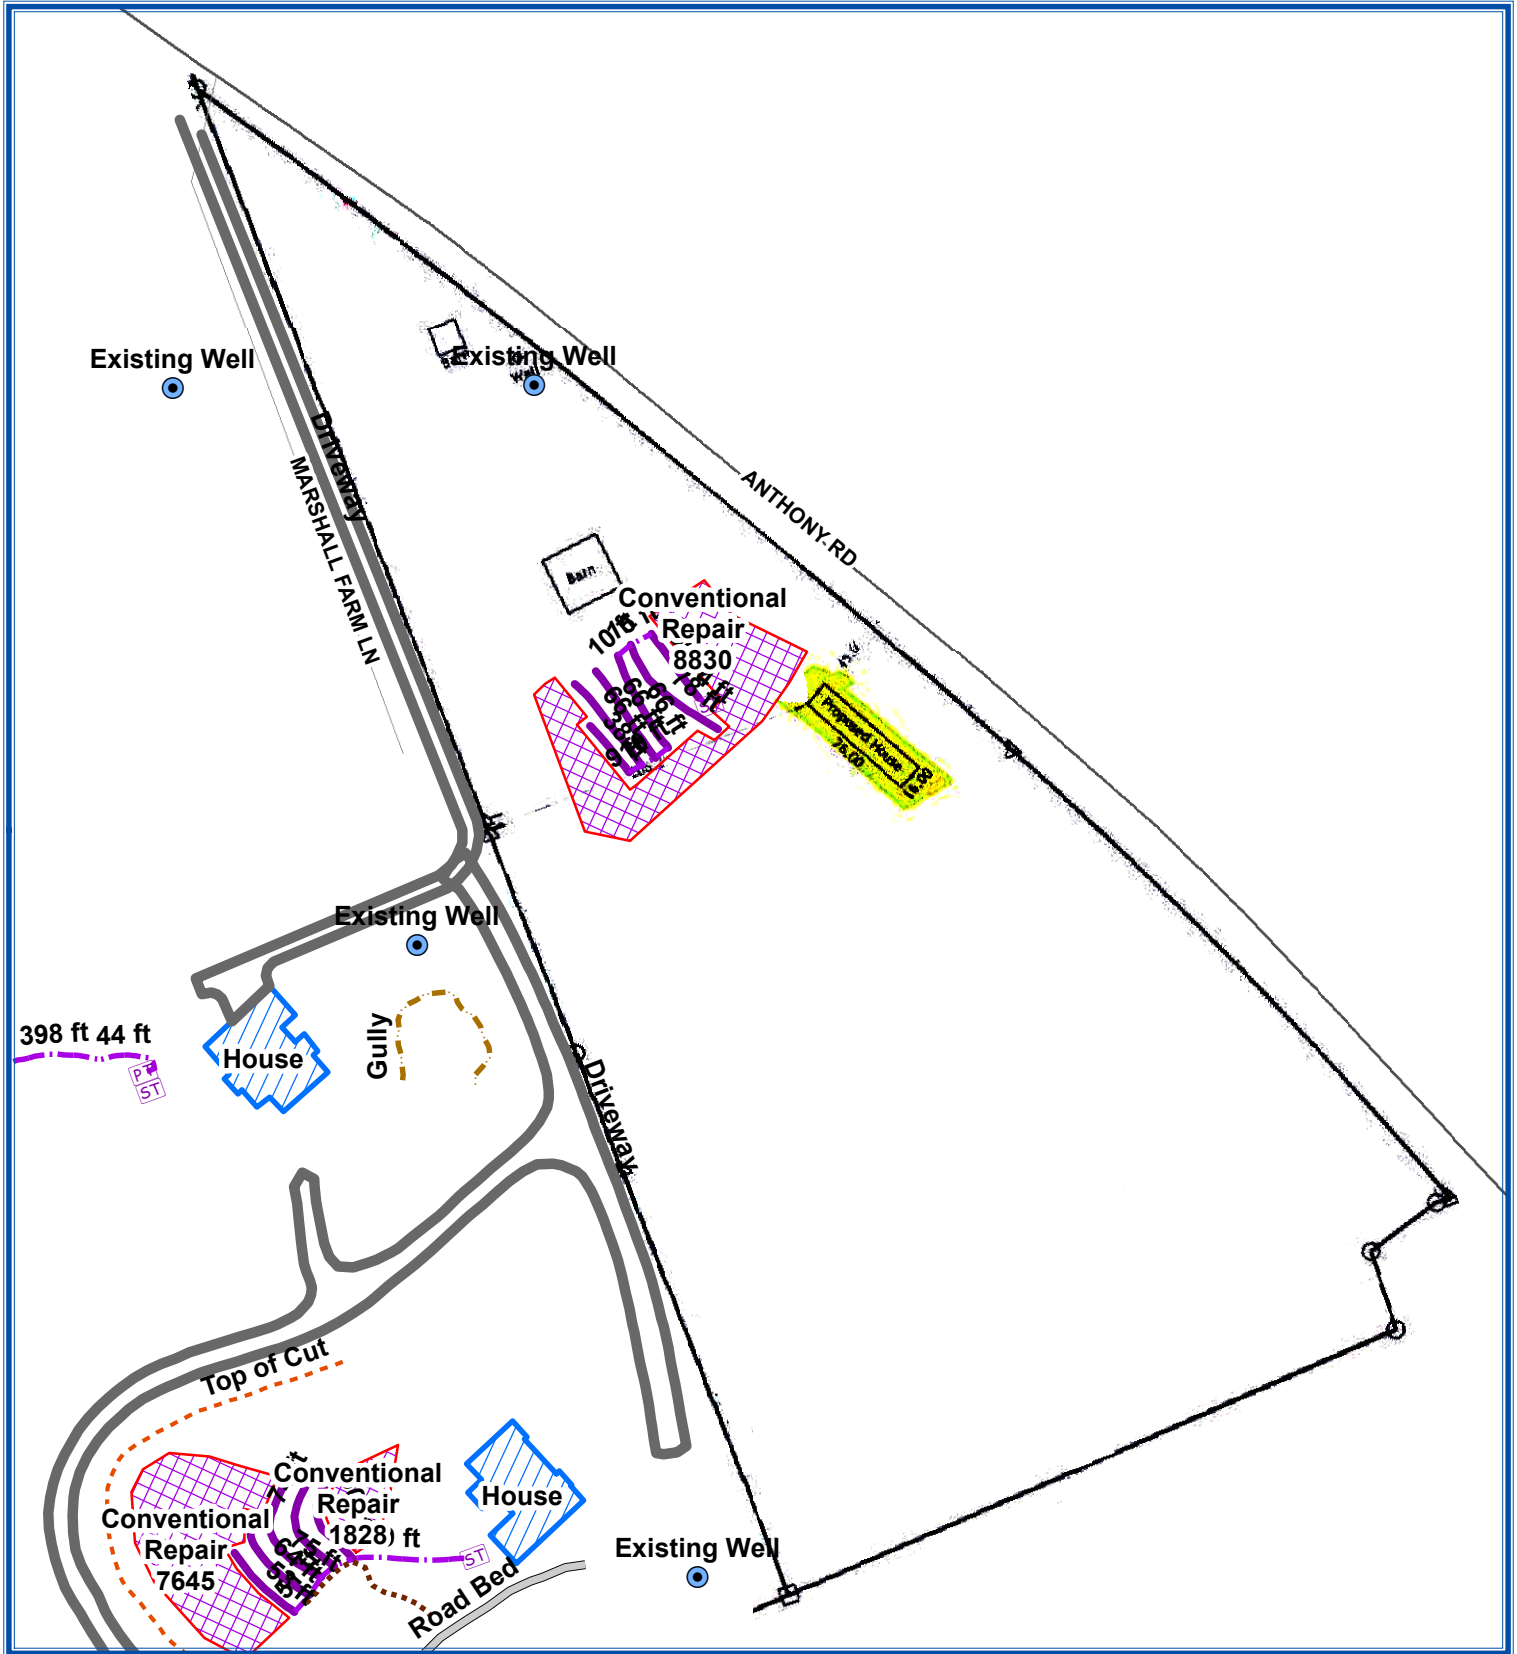

Address: 7683 Anthony Rd
 Permit #: 20-06-SNHR-03715
 Issuer's Initials: KCM
 Date: 7/6/2022

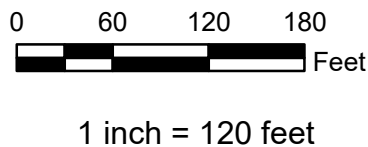

DISCLAIMER:
 The data shown in this map is for public use. Guilford County makes no warranty to its accuracy; all data sets and maps are for geographical representation only.

CONDITIONS:

Initial system and designated repair areas must be protected from traffic, construction, destruction, cultivation, landscaping, erosion, or any other circumstances that may alter site conditions and may cause problems with the initial system or the future system as permitted.

Surface and/or subsurface drainage diversion around the system must be maintained as permitted.

Heavy vegetative growth over drainfields and the root system of many shallow-rooted trees are detrimental to the proper operation of subsurface sewage systems and must be controlled periodically.

All subsurface sewage disposal systems must be maintained and operated in a manner that prevents surface discharge or any other potential public health concerns. All public health concerns created by the operation of this system must be addressed immediately (within 48 hours). Required permits to correct the public health concern must be obtained from the Environmental Health Water Quality Unit and corrections to the system are to be completed within 30 days of the date of that permit.


Establish cover over drainlines.

Access to tanks, tank components (pumps, float controls, valves, etc.), drainfields, or other system components must be maintained to allow periodic follow up inspections as required and/or to evaluate system concerns.


To avoid damage to the system, the septic tanks should be pumped out every 3-5 years.



Diagram

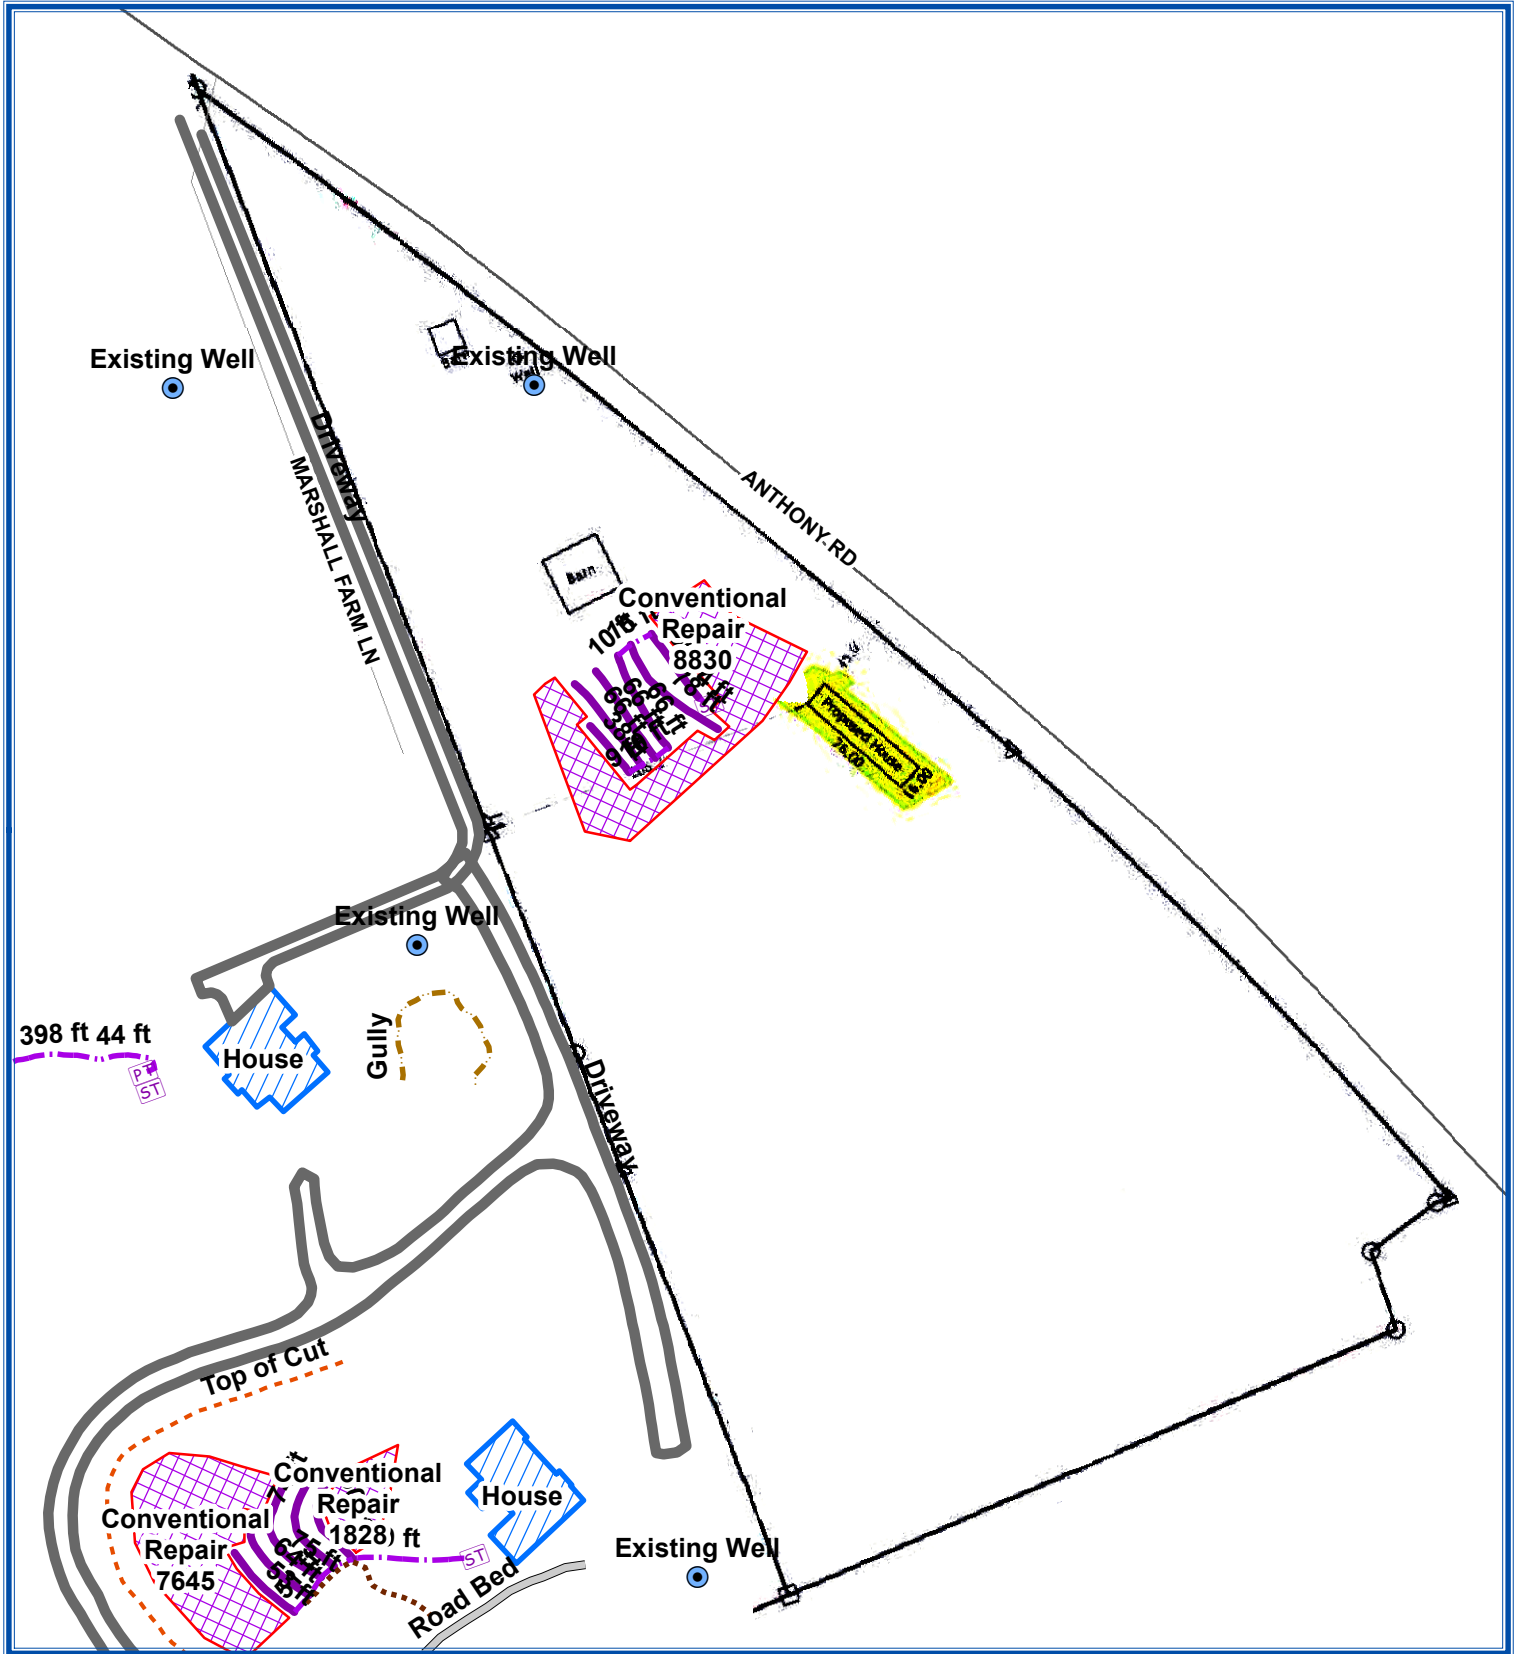

Address: 7683 Anthony Rd
 Permit #: 20-06-SNHR-03715
 Issuer's Initials: KCM
 Date: 6/13/2022

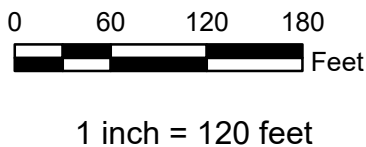

DISCLAIMER:
 The data shown in this map is for public use. Guilford County makes no warranty to its accuracy; all data sets and maps are for geographical representation only.




4/9/22

Septic Final

Diagram

Glenn Meredith

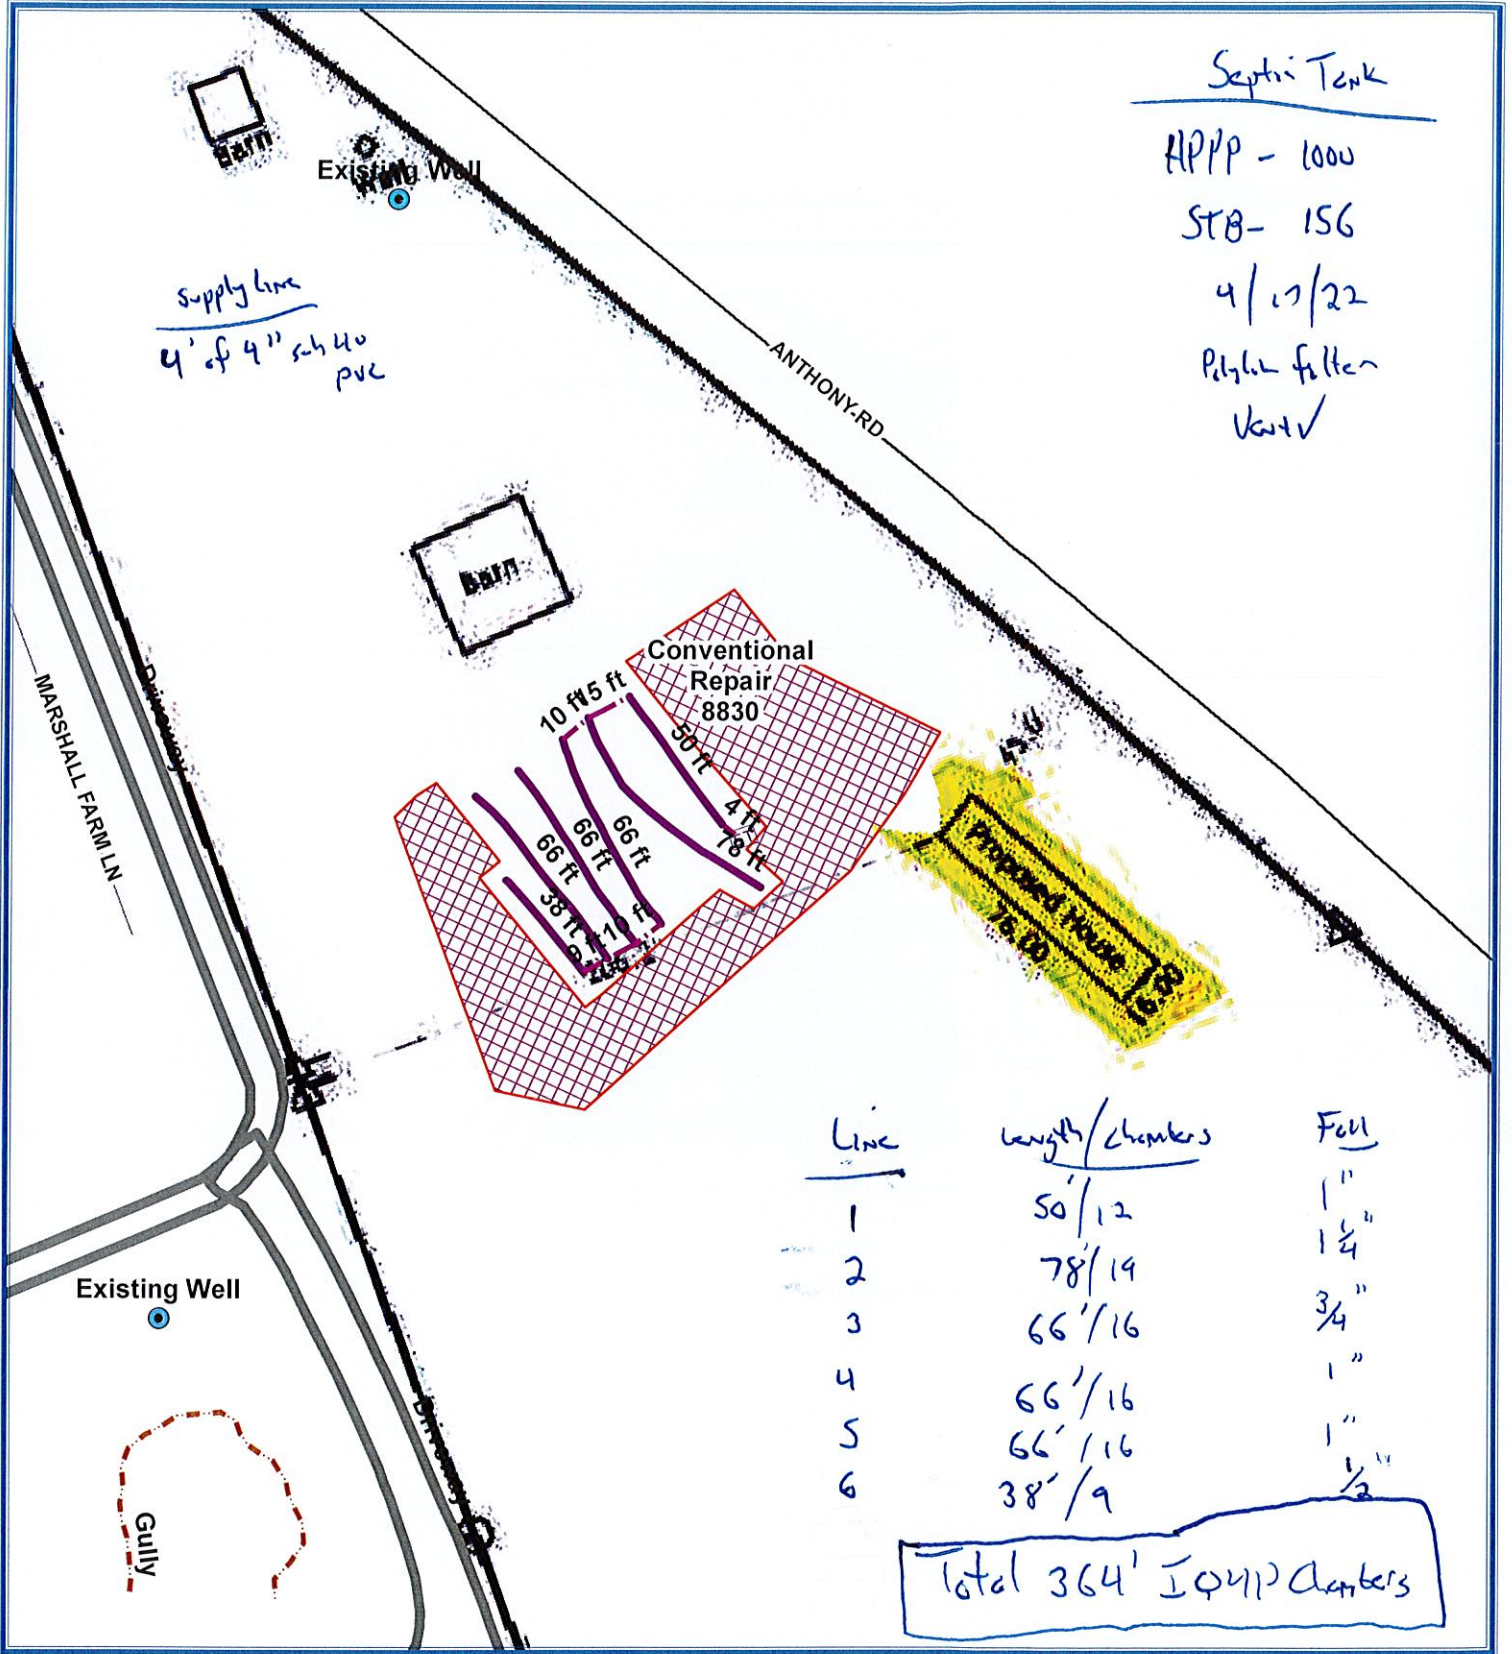

Address: 7683 Anthony Rd
 Permit #: 20-06-SNHR-03715
 Issuer's Initials: KCM
 Date: 6/13/2022



1 inch = 60 feet

DISCLAIMER:
 The data shown in this map is for public use. Guilford County makes no warranty to its accuracy; all data sets and maps are for geographical representation only.



Environmental Health Division
 Water Quality Section
 400 W Market St.
 Greensboro, NC 27401
 (336) 641-7613



Authorization for Wastewater System Construction

Address: 7683 Anthony RD, Kernersville, NC 27284

Permit Number: 21-08-SNHR-06915

This Construction Authorization shall be valid for five years from the issue date of the Improvement Permit. The area designated for a Subsurface Sewage Treatment and Disposal System shall not be graded and appropriate measures shall be taken to prevent vehicular traffic, erosion, or any other disturbance to the site. Disturbance of this area, change of site plan, or change of intended use could result in the suspension or revocation of this Authorization.

System Type:	2a - Conventional	Wastewater Flow:	360	GPD
Repair System Type:	2a - Conventional	Facility Type:	Residence	
Trench Length:	480 ft	Bedrooms:	3	
Trench Depth:	18 in to 20 in	<u>Site Requirements:</u>		
Trench Width:	36 in	Setback:	45	ft off of the Front
Gravel Depth:	12 in	Offset:	/	ft off of the
Trench Separation:	9 ft On-Center	Setup:	206	ft off of the rear
Soil Cover:	6 in to 8 in	Basement:	N	
Septic Tank Size:	1000 gal	Well Site:	Right Front	
Pump Tank Size:	/ gal	Repair Area Maintained:	Y	
Dosing Volume:	/ gal to gal			

Authorization Issued:

Shane N R Prens
 Environmental Health Specialist

Date Issued:

5/26/22

Owner or Authorized Agent:

Mina Barnes
 Owner or Authorized Agent

Date:


5/26/22

Comments:


Plumb out right side.
 Keep system within the approved area.
 All property lines and corners shall be flagged before installation.
 Keep nitrification trench bottoms level and maintain a constant trench depth in each line.
 Must maintain a minimum of 100 feet separation from any well.

ConstructionAuth

Diagram

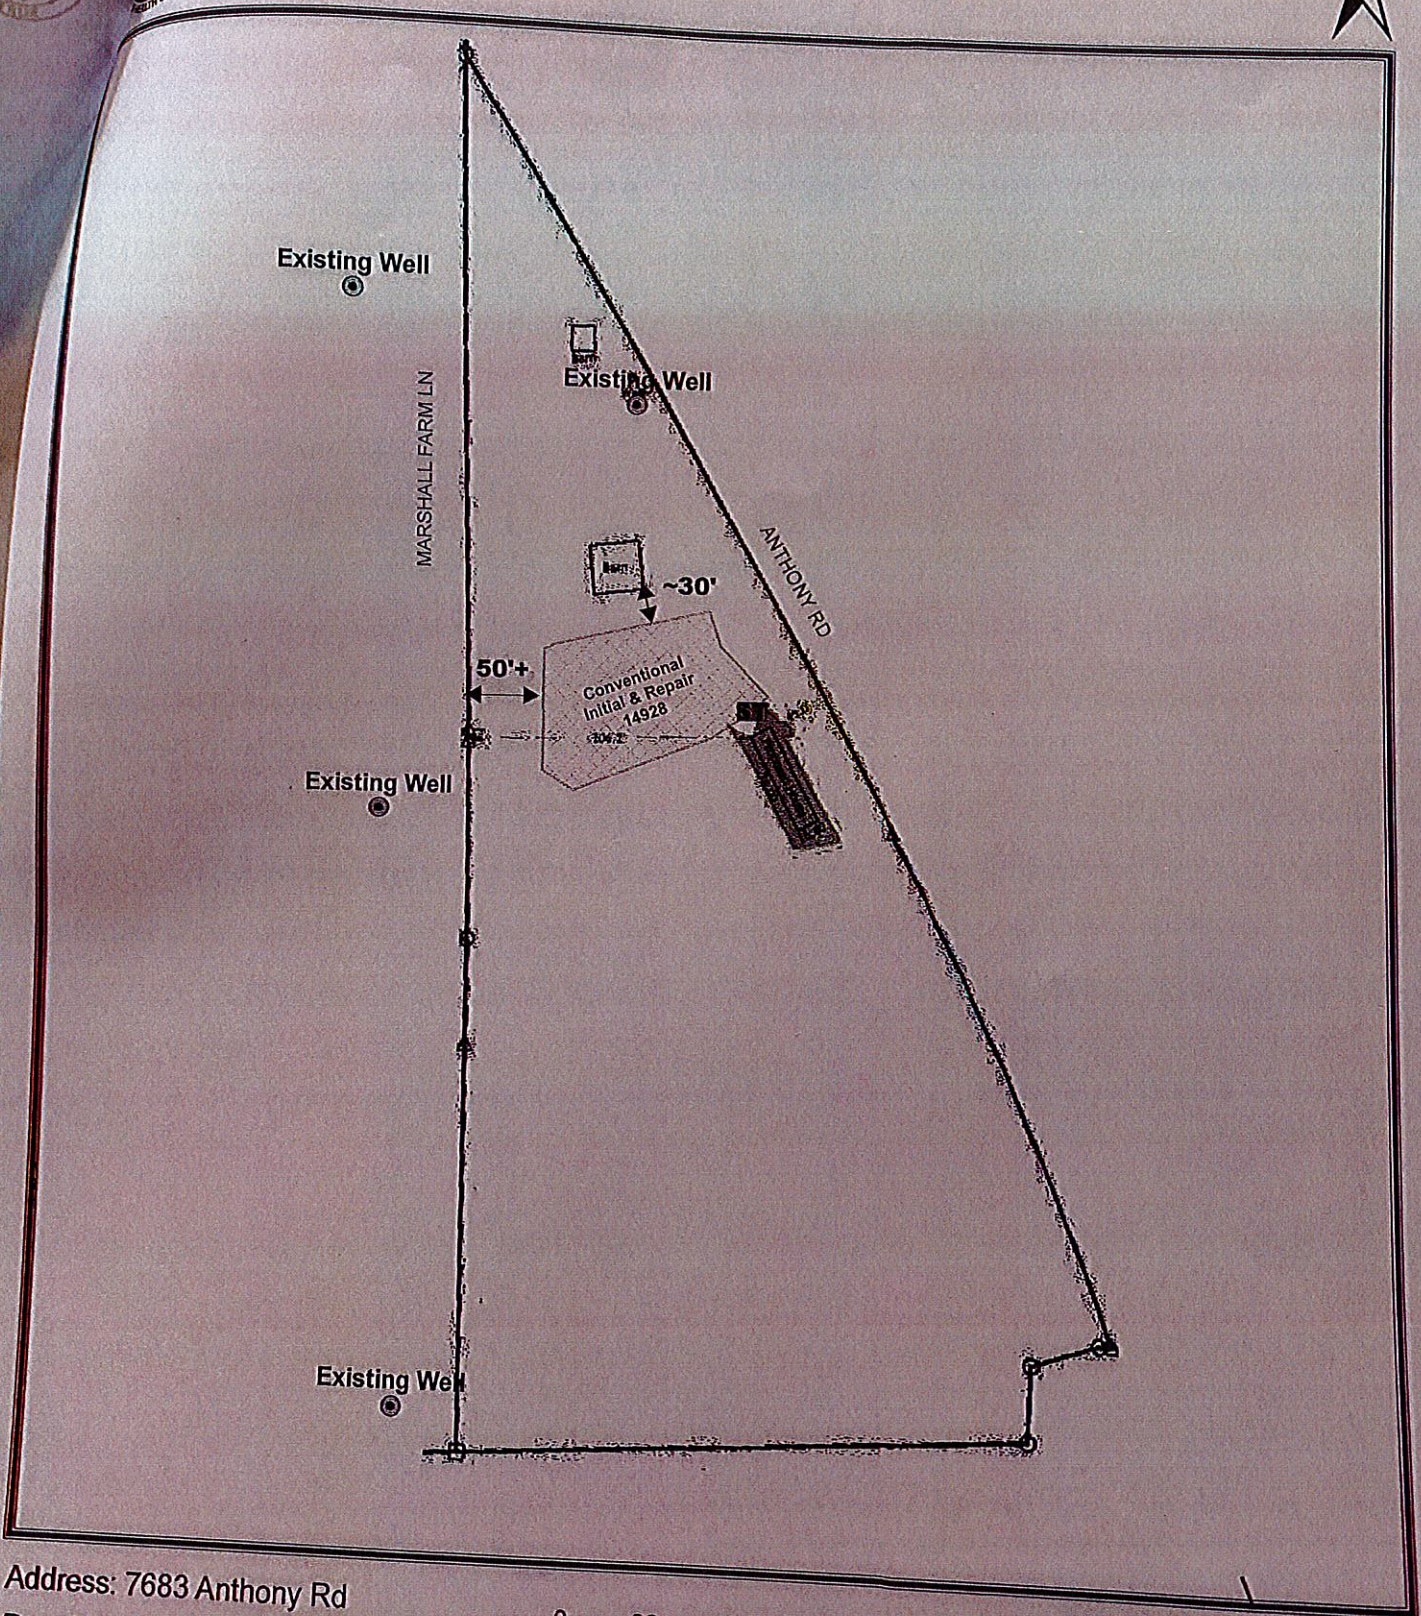

Address: 7683 Anthony Rd
Permit #: 21-08-SNHR-06915
Issuer's Initials: SKB
Date: 5/25/2022



1 inch = 129 feet


DISCLAIMER:
The data shown in this map is for public use. Guilford County makes no warranty to its accuracy; all data sets and maps are for geographical representation only.



400 W. Market Street
Greensboro, NC 27401

MEMORANDUM

TO: K. Joe Johnson, REHS
FROM: Heath Ward, REHS
DATE: May 31, 2022
RE: Refund for: 7683 Anthony Rd

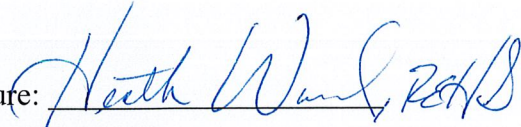Signature: 

Receipt number: 234178
Date: May 16, 2022
Amount: \$200.00
Send refund to: Tammy Gravley
7690 Anthony Rd
Kernersville, NC 27284

I would like to request a refund be given for the following reasons:

- Client changed mind and decided not to have service performed.
- Client did not apply for the correct service and has or will apply for a different service.
- Planning and Development Department charged client the wrong fee for a plat.

Other: \$300 was collected in error for a 3 bedroom soil evaluation. Soil evaluation had been done and an Improvement Permit issued on May 26, 2021. \$100 applied to Construction Authorization leaving \$200 balance.



GUILFORD COUNTY RECEIPT

Planning & Development
400 West Market Street
Greensboro, NC 27402
336-641-3334 - Planning
336-641-3707 - Permitting

Environmental Health
400 West Market Street
Greensboro, NC 27402
336-641-7613

RECEIPT INFO

<u>Receipt #</u>	<u>Receipt Date</u>	<u>Payor</u>	<u>Payment Method</u>	<u>Check/CC #</u>	<u>Receipt Amount</u>
166544	05/16/2022	TAMMY GRAVLEY	Master Card		\$300.00

Cashier ID: JBAUMGA

<u>Fee Item Description</u>	<u>Account Code</u>	<u>Amount</u>
Residential Soil Evaluation	210545 45122	\$300.00
	Total	\$300.00

APPLICATION INFO

<u>Application #</u>	<u>Application Type</u>	<u>Application Name</u>
22-05-SNHR-03629	Building/Guilford County/Health Residential/Soil Evaluations New	

PROPERTY INFO

<u>Property Address</u>	<u>Property Owner</u>	<u>Parcel #</u>
7683 ANTHONY RD KERNERSVILLE, NC 27284	Marty & Tammy Gravley 7690 Anthony Rd Kernersville, Nc 27284	234178

CONTACT INFO

<u>Contact Name</u>	<u>Contact Type</u>
Gina Barnes 916 Van Buren Rd Eden, Nc 27288	Applicant

LICENSED PROFESSIONAL INFO

<u>Primary</u>	<u>License #</u>	<u>License Type</u>	<u>Licensed Prof</u>	<u>Business Name</u>	<u>Lawson #</u>
----------------	------------------	---------------------	----------------------	----------------------	-----------------



Guilford County Application For Improvement Permit and/or Authorization to Construct

- Scaled site plan submitted -- (Valid 60 Months)
- Unscaled site plan submitted -- (Valid 60 months)
- Survey plat to scale* submitted -- (Valid without expiration)
- * scale of 1" = no more than 60'

Soil!
TP
XXXX

21-08-SNHR-06915

Building Permit # 22-05-STRP - Septic Permit # XXXXXXXXXXXX Well Permit # _____

PROPERTY INFORMATION

Address 71683 Anthony Rd City KEENEYSVILLE, NC 27284 Parcel REID # 234178
 Development Name _____ Section/Phase # _____ Lot # _____ Plat Book # 207-50 Page # _____
 Lot of Record First Lot Out Plat Required >5 acres (5-17-65 to 2-1-74) >10 acres (2-1-74 to present)
 Date Lot Originally Deeded & Recorded 12-31-87

ZONING INFORMATION

Zoning: AG Conditional Zoning (Describe): _____
 Watershed: _____ Watershed Critical Area: _____
 Building Setbacks (Zoning): Front Street: 40 Side Street: 40 Side Yard: 15 Rear: 30
 Comments: 3 BORN SOIL EVALUATION

PLANNING DEPARTMENT OFFICIAL: _____

APPLICANT INFORMATION

Applicant Name: Dakwood Homes Address: 916 S. Van Buren Rd. Eden, NC 27289
 Phone 1: 336-710-1588 Phone 2: _____ Email: Gina.Barnes@DakwoodHomes.com
 Owner Name: Maety + Tanny Gravley Address: 7683 Anthony Rd K'ville 27284
 Phone 1: 336-609-0885 Phone 2: _____ Email: mtgravley@yahoo.com

DEVELOPMENT INFORMATION


NEW ACCESSORY SWMH MULTIFAMILY/DUPLEX ADDITION (TYPE) _____
 HOUSE MODULAR DWMH RENOVATION OTHER TYPE _____
 Residential Specifications: Max # of Bedrooms: 3 MAX. # of Occupants: 2 Total # of Rooms: 7 Size of Structure (sq ft): 1,216
 Basement: Yes No Basement Fixtures: Yes No
 Non-Residential Type: Commercial Industrial Other _____
 Wastewater Strength: Domestic High Strength Industrial Process
 MAX. # of Employees: _____ # of Fixtures: _____ Plumbing: _____ Size of Structure (sq ft): _____
 Description of Facility: _____
 Other Flow Related Info (# Seats (e.g. Restaurant), # Chairs (e.g. Beauty Shop), # Spaces, Etc.): _____

Water Supply Proposed: New Well Existing Well Community Well Public Water Spring
 Are there any existing wells, springs, or waterlines on this property? Yes No

Sewage Disposal: Please Indicate Desired System Type (see back)
 Conventional Accepted Modified Alternative Other _____

The applicant shall notify the local health department upon submittal of this application if any of the following apply to the property in question. If the answer to any question is "yes", applicant must attach supporting documentation.

- | | | |
|------------------------------|--|---|
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Does the site contain any jurisdictional wetlands? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Does the site contain any existing wastewater systems? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Is any wastewater going to be generated on the site other than domestic sewage? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Is the site subject to approval by any other public agency? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Are there any easements or right of ways on this property? |

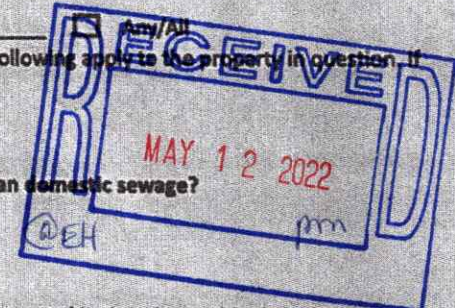

I have read this application and certify that the information provided herein is true, complete and correct and is given in good faith. Authorized County and State Officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners, making the site accessible so that a complete site evaluation can be performed, and compliance with applicable governing regulations.

IF THE INFORMATION IN THE APPLICATION FOR AN IMPROVEMENT PERMIT IS FALSIFIED, CHANGED, OR THE SITE IS ALTERED, THEN THE IMPROVEMENT PERMIT AND AUTHORIZATION TO CONSTRUCT MAY BECOME INVALID.

Gina Barnes
 Property Owner's or Owner's Legal Representative* Signature (Required)
 * Must provide documentation to support claim as owner's legal representative.
 Date: 5/12/22
 Address: NC 68 N, 1/2 Haw River Rd, 1/2 Warner Rd, 1/2 Anthony Rd; prop. on left @ Marshall Farm Ln

234178

7683 Anthony Rd

Notes:

1. No NCGS Monuments found within 2000' of property.
2. This project is not located within a special flood hazard area.
3. Area calculated by coordinate geometry.
4. All lines surveyed by Jerry C Callicutt are indicated by bold lines. All lines not surveyed by Jerry C Callicutt are indicated by dashed lines.
5. No attempt was made by this survey to locate all underground utilities nor any other easements that would be revealed by a title search.
6. Deeds and plats referenced (Guilford Co. registry):
Deeds:
DB 3468 PG 557
7. Guilford County Tax PIN: 7900323204

GUILFORD COUNTY
PLANNING & DEV.
PERMIT # 22-05-STRP-0353
AG
F90515

Legend

- Property Line
- Calculated Property Line
- Right of Way Line
- Easement Line
- Tie Lines
- Old Plat Book Line
- Existing Iron Rod/Pipe
- NIR
- Point Not Set/Computed Point
- Well



Location Map (1"=2000')

STATE OF NORTH CAROLINA

I, _____ Review Officer of Guilford County, certify that the map or plat to which this certification is affixed meets all statutory requirements for recording.

Date _____ Review Officer _____

This map has not been reviewed by the Guilford County Planning Department



This plat does not require certificate of approval by the division of highways as provided in G.S. 136-102.6, Subsection (g)

Signed: _____ Date _____
Town of Stokesdale Enforcement Officer

I (We) hereby certify that I am (we are) the owner(s) of the property shown and described hereon and that I (we) hereby adopt this plan of subdivision with my (our) free consent.

Date _____ Owner _____
Date _____ Owner _____
Date _____ Witness _____

I, Jerry C. Callicutt, Professional Land Surveyor, certify:

In accordance with NC General Statute 47-30(f)(11)d That the survey is of another category, such as the recombination of existing parcels, a court-ordered survey, or other exemption or exception to the definition of subdivision.

I, Jerry C. Callicutt, certify that this plat was drawn under my supervision from an actual survey made under my supervision (deed description recorded in:

Book 3468, page 557

that the boundaries not surveyed are clearly indicated as drawn from information found in Book See, page Notes; that the ratio of precision or positional accuracy as calculated is 1:10000+; that this plat was prepared in accordance with G.S. 47-30 as amended. Witness my original signature, license number and seal this the 30th day of June, A.D., 2021.



CHORD	RADIUS	ARC LENGTH	CHORD LENGTH	CHORD BEARING	DELTA ANGLE
CL	2882.01	337.96	337.66	S 24° 35' 22" E	8° 16' 28"
CL	1504.88	130.55	130.38	S 31° 28' 02" E	5° 45' 04"

LINE	BEARING	DISTANCE
L1	N 01° 52' 45" W	8.19
L2	S 12° 26' 18" W	49.65
L3	S 74° 09' 37" W	48.97
L4	N 8° 38' 12" W	8.65
L5	N 35° 38' 09" W	52.00
L6	S 2° 28' 12" E	87.75
L7	N 01° 51' 50" W	15.04

Parcel Notes:

Parcel #: 166852
 Owner: Marty Ray and Tammy P. Gravley
 Address: 1830 Neelley Rd
 Deed Ref: DB 3468 Pg 557
 Acreage: 51.84
 Zoning: AG & RS-40
 Use: Residential
 WS: None

7684


7683

5.783 Acres



Exemption Map Subdivision for: Marty Ray & Tammy P. Gravley

Oak Ridge Township Guilford County
 North Carolina June 30, 2021
 Scale: 1" = 80 US Survey Feet



Jerry C. Callicutt, PLS
 3618 Sainsbury Lane
 Greensboro, NC 27409
 336 706-9239



Environmental Health Division
Water Quality Section
400 W. Market St.
Greensboro, NC 27401
(336) 641-7613

Improvement Permit

Address: 7684 Anthony RD, Kernersville, NC 27284

Permit Number: 21-08-SNHR-06915

This Improvement Permit shall be valid for 5 Years from the date issued upon a satisfactory showing to the health department that the site and soil conditions are unaltered, that the facility, design wastewater flow, and wastewater characteristics are not increased, and that the wastewater system can be installed to meet the following requirements that were in effect on the date the Improvement Permit was issued.

Design Flow: 360

Facility Type: Residence

Bedrooms: 3

Conditions: Initial - Conventional
Repair - Conventional


Do not grade or disturb the approved area. Disturbance of this area, change of site plan, or change of intended use could result in the suspension or revocation of this permit. This is not an Authorization to Construct a Wastewater System. The authorization for wastewater system construction with system specifications must be completed before any building permits or system installation can commence.

Permit Issued: Shane A B REAS
Environmental Health Specialist


Date Issued: 8/12/21



Diagram

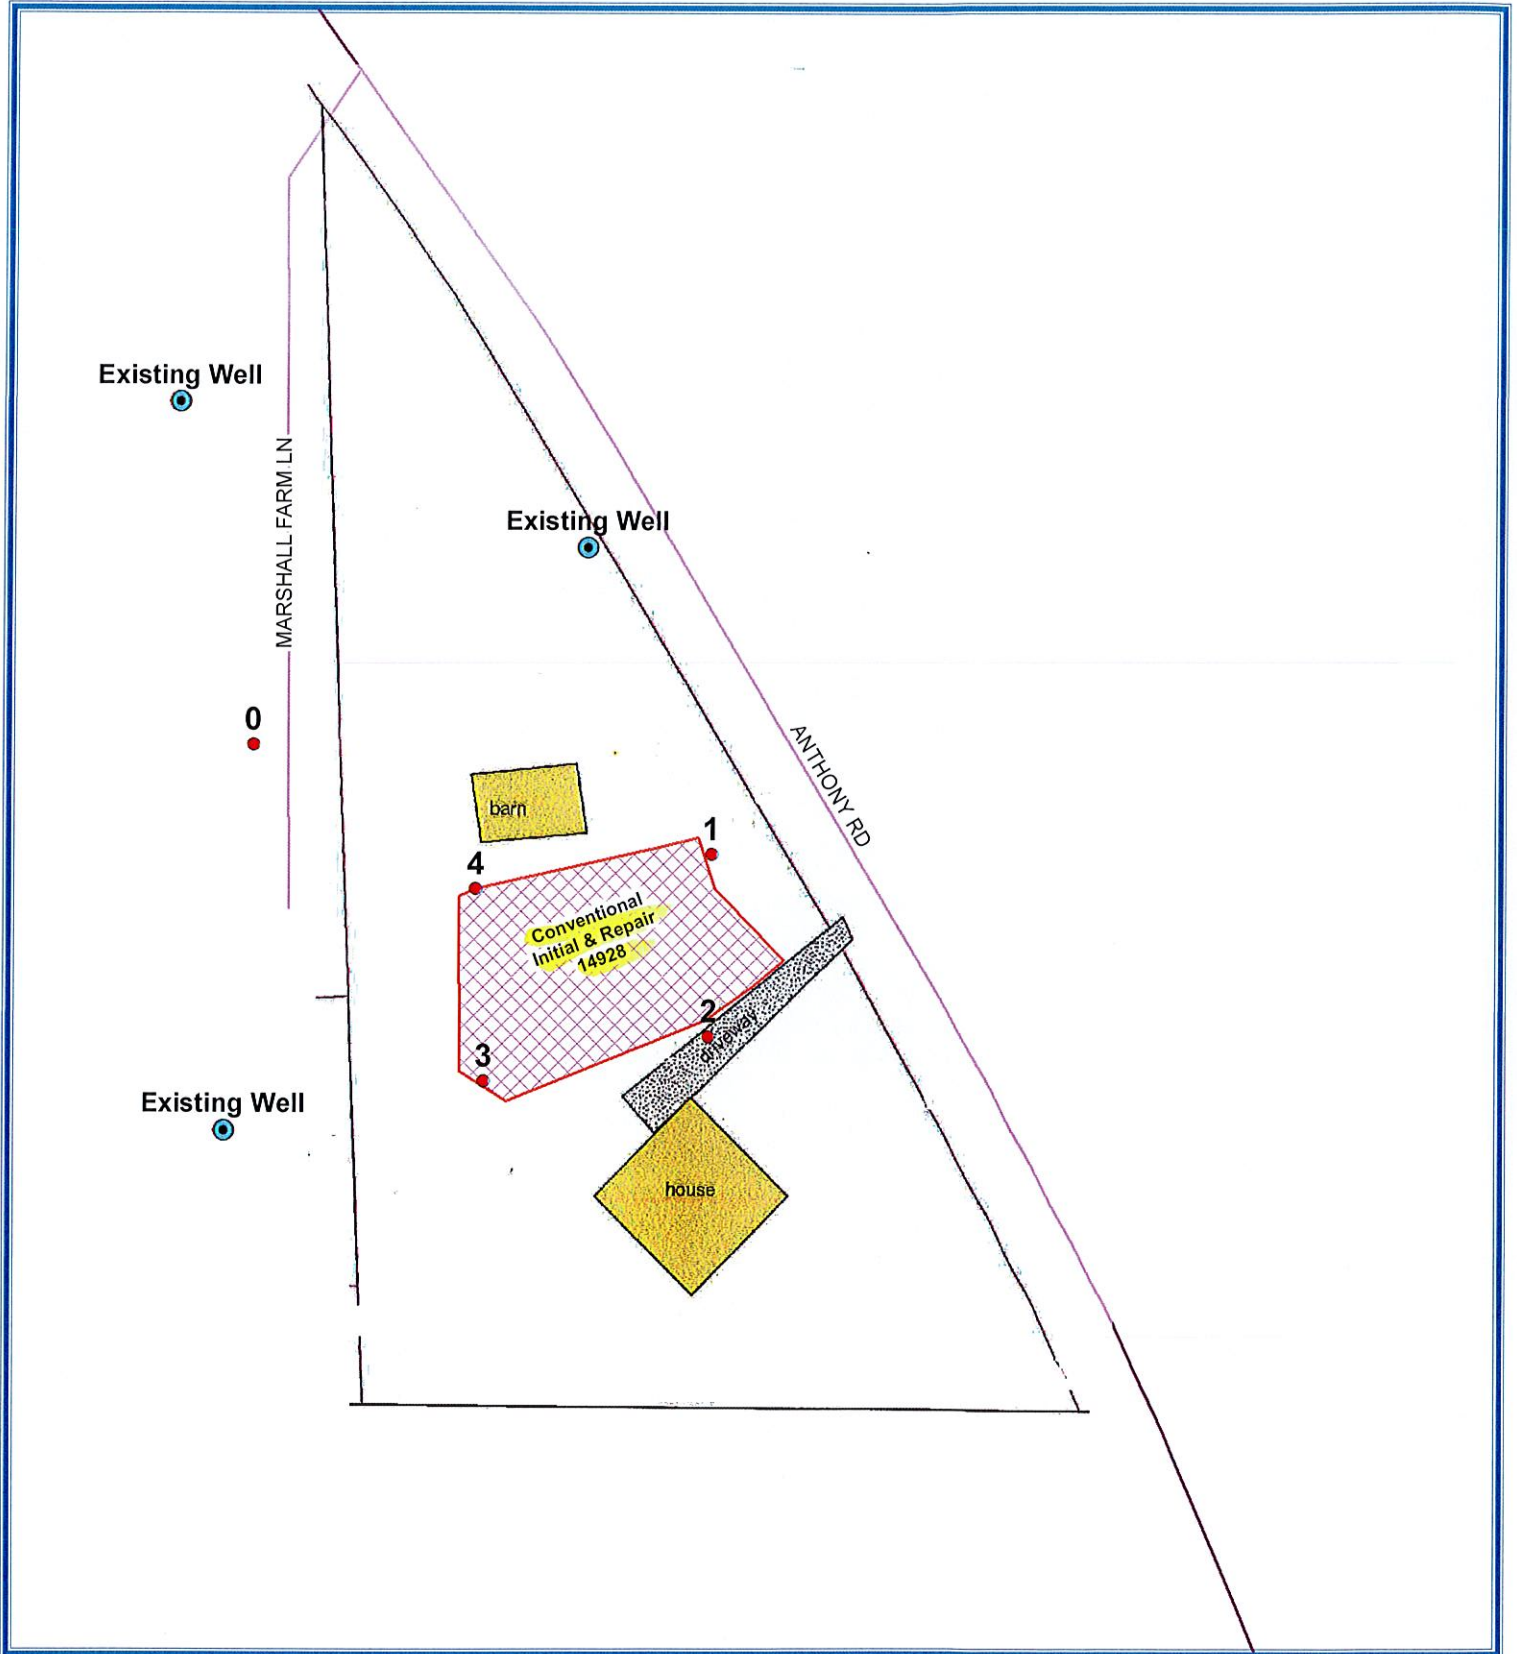

Address: 7684 Anthony Rd
Permit #: 21-08-SNHR-06915
Issuer's Initials: SKB
Date: 8/12/2021

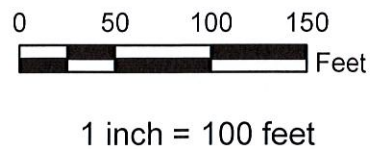

DISCLAIMER:
The data shown in this map is for public use. Guilford County makes no warranty to its accuracy; all data sets and maps are for geographical representation only.

#	1	2	3	4
landscp	L	L	L	L
slope	3	6	5	5
H1_depth	0 - 10	0 - 12	0 - 10	0 - 10
H1_text	SCL	SCL	SCL	SCL
H1_consist	Fr	Fr	Fr	Fr
H1_struct	WBK	WBK	WBK	WBK
H1_minrl	SEXP	SEXP	SEXP	SEXP
H2_depth	10 - 26	12 - 25	10 - 25	10 - 25
H2_text	Clay	Clay	Clay	Clay
H2_consist	Fi	Fi	Fi	Fi
H2_struct	BK	BK	BK	BK
H2_minrl	SEXP	SEXP	SEXP	SEXP
H3_depth	26 - 40	25 - 36	25 - 33	25 - 38
H3_text	CL (BC)	CL (BC)	CL (BC)	CL (BC)
H3_consist	Fr	Fr	Fr	Fr
H3_struct	WBK	WBK	WBK	WBK
H3_minrl	SEXP	SEXP	SEXP	SEXP
H4_depth				
H4_text				
H4_consist				
H4_struct				
H4_minrl				
soil_wet				
saprolite	40	36	33	38
class	PS	PS	PS	PS
ltar	0.275	0.25	0.25	0.25
notes	Sap	Sap	Sap	Sap
eval_by	SKB	SKB	SKB	SKB
eval_date	08/10/21	08/10/21	08/10/21	08/10/21
Initial/Repair LTAR	0.25/.25			
Initial/Repair System Type	conv/conv			



Guilford County Application For Improvement Permit and/or Authorization to Construct

- Scaled site plan submitted – (Valid 60 Months)
- Unscaled site plan submitted – (Valid 60 months)
- Survey plat to scale* submitted – (Valid without expiration)
- * scale of 1" = no more than 60'

Building Permit # _____ Septic Permit # 21-08-SNHR-06915 Well Permit # _____

PROPERTY INFORMATION

Address 7684 Anthony Rd City Kernersville 27284 Parcel REID # 166852
 Development Name _____ Section/Phase # _____ Lot # _____ Plat Book # _____ Page # _____
 Lot of Record First Lot Out Plat Required >5 acres (5-17-65 to 2-1-74) >10 acres (2-1-74 to present)
 Date Lot Originally Deeded & Recorded _____

ZONING INFORMATION

Zoning: _____ Conditional Zoning (Describe): _____
 Watershed: _____ Watershed Critical Area: _____
 Building Setbacks (Zoning): Front Street: _____ Side Street: _____ Side Yard: _____ Rear: _____
 Comments: _____

PLANNING DEPARTMENT OFFICIAL: _____

APPLICANT INFORMATION

Applicant Name: WAYNE JONES Address: 2721 BRIARDAK DR CLIMAX NC 27233
 Phone 1: 336 202-4989 Phone 2: 336 685-4457 Email: LANDMAR@TRIAD.RR.COM
 Owner Name: Marty Gravley Address: 7690 Anthony Road Kernersville 27284
 Phone 1: _____ Phone 2: _____ Email: _____

DEVELOPMENT INFORMATION

NEW ACCESSORY SWMH MULTIFAMILY/DUPLEX ADDITION (TYPE) _____
 HOUSE MODULAR DWMH RENOVATION OTHER TYPE _____
Residential Specifications: Max # of Bedrooms: 3 MAX. # of Occupants: 6 Total # of Rooms: 6 Size of Structure (sq ft): 3000
 Basement: Yes No Basement Fixtures: Yes No
Non-Residential Type: Commercial Industrial Other _____
Wastewater Strength: Domestic High Strength Industrial Process
 MAX. # of Employees: _____ # of Fixtures: _____ Plumbing: _____ Size of Structure (sq ft): _____
 Description of Facility: _____
 Other Flow Related Info (# Seats (e.g. Restaurant), # Chairs (e.g. Beauty Shop), # Spaces, Etc.): _____

Water Supply Proposed: New Well Existing Well Community Well Public Water Spring
 Are there any existing wells, springs, or waterlines on this property? Yes No

Sewage Disposal: Please Indicate Desired System Type (see back)
 Conventional Accepted Modified Alternative Other _____ Any/All

The applicant shall notify the local health department upon submittal of this application if any of the following apply to the property in question. If the answer to any question is "yes", applicant must attach supporting documentation.

- | | | |
|------------------------------|--|---|
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Does the site contain any jurisdictional wetlands? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Does the site contain any existing wastewater systems? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Is any wastewater going to be generated on the site other than domestic sewage? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Is the site subject to approval by any other public agency? |
| <input type="checkbox"/> YES | <input checked="" type="checkbox"/> NO | Are there any easements or right of ways on this property? |


I have read this application and certify that the information provided herein is true, complete and correct and is given in good faith. Authorized County and State Officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners, making the site accessible so that a complete site evaluation can be performed, and compliance with applicable governing regulations.

IF THE INFORMATION IN THE APPLICATION FOR AN IMPROVEMENT PERMIT IS FALSIFIED, CHANGED, OR THE SITE IS ALTERED, THEN THE IMPROVEMENT PERMIT AND AUTHORIZATION TO CONSTRUCT MAY BECOME INVALID.

Wayne Jones
 Property Owner's or Owner's Legal Representative* Signature (Required)

8/4/21
 Date

* Must provide documentation to support claim as owner's legal representative.

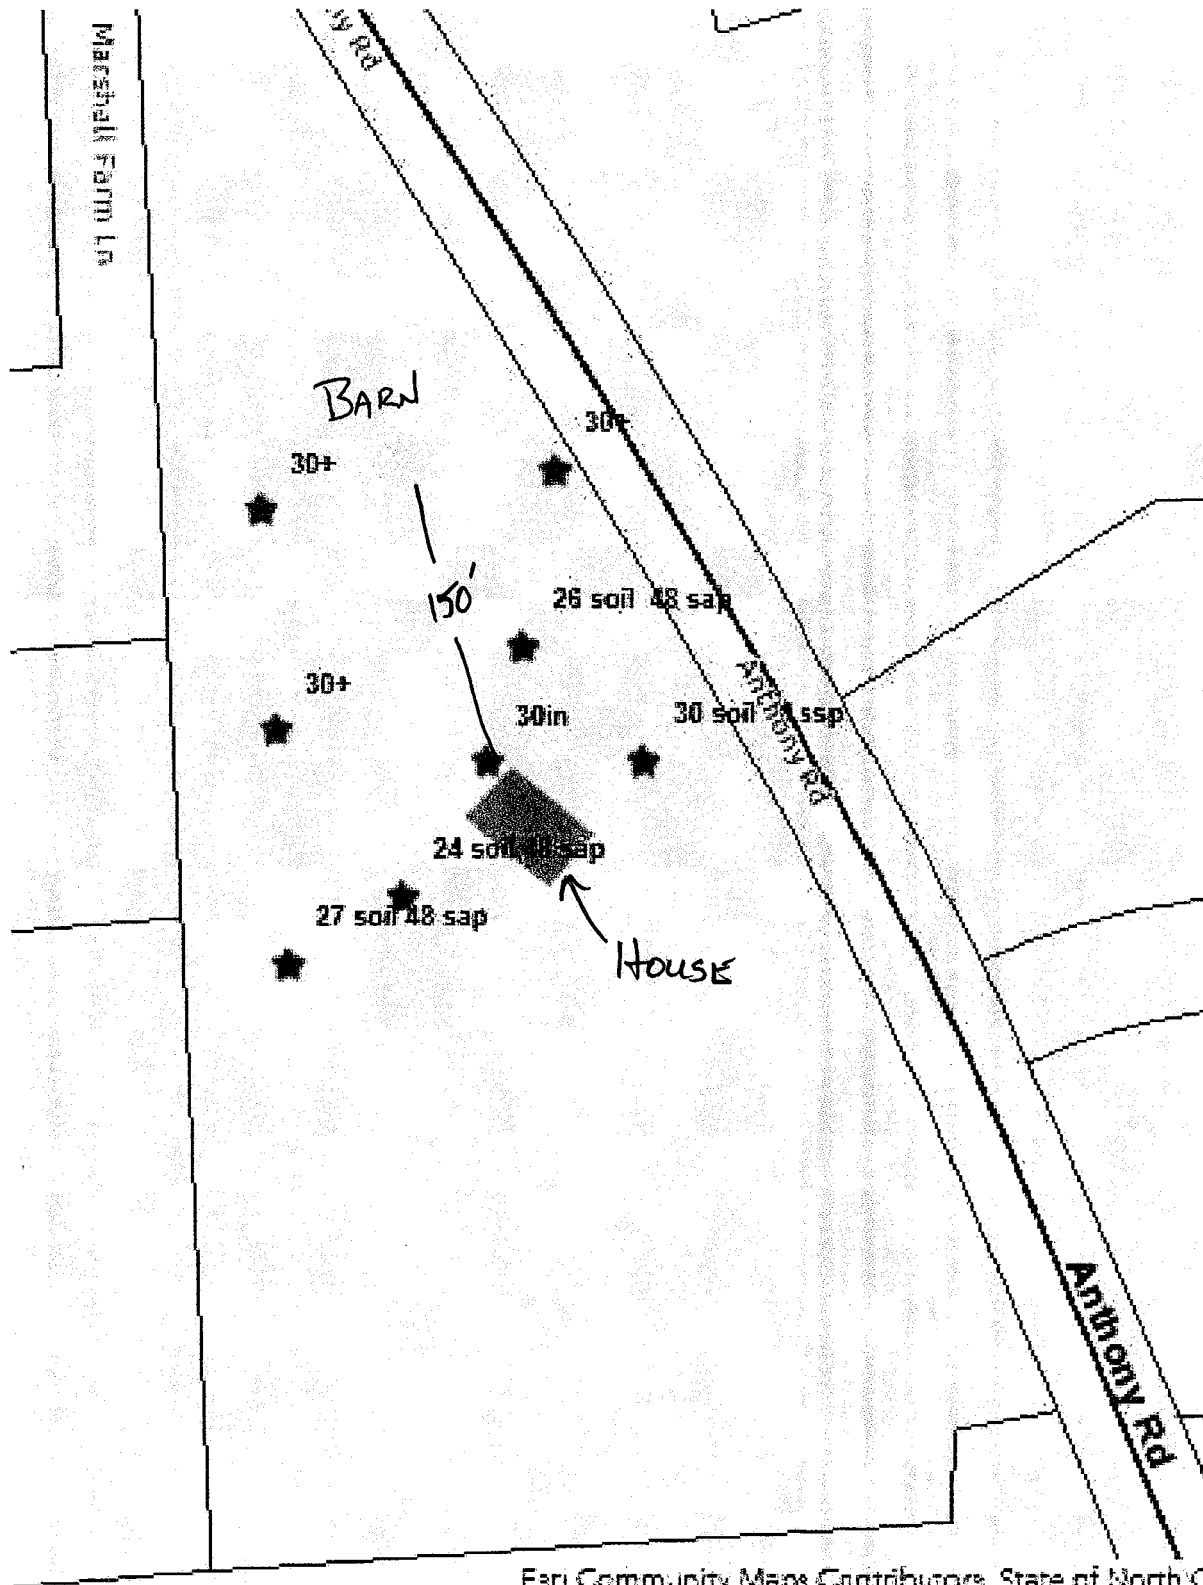



GUILFORD COUNTY RECEIPT

Planning & Development
400 West Market Street
Greensboro, NC 27402
336-641-3334 - Planning
336-641-3707 - Permitting

Environmental Health
400 West Market Street
Greensboro, NC 27402
336-641-7613

RECEIPT INFO

<u>Receipt #</u>	<u>Receipt Date</u>	<u>Payor</u>	<u>Payment Method</u>	<u>Check/CC #</u>	<u>Receipt Amount</u>
158690	08/06/2021	Landmark Environmental	Check	1390	\$300.00

Cashier ID: SFLANAG

<u>Fee Item Description</u>	<u>Account Code</u>	<u>Amount</u>
Residential Soil Evaluation	210545 45122	\$300.00
	Total	\$300.00

APPLICATION INFO

<u>Application #</u>	<u>Application Type</u>	<u>Application Name</u>
21-08-SNHR-06915	Building/Guilford County/Health Residential/Soil Evaluations New	

PROPERTY INFO

<u>Property Address</u>	<u>Property Owner</u>	<u>Parcel #</u>
7684 Anthony RD Kernersville, NC 27284	Marty Gravley 7690 Anthony Rd Kernersville, Nc 27284	166852

CONTACT INFO

<u>Contact Name</u>	<u>Contact Type</u>
Wayne Jones 2721 BriarOak Dr Climax, Nc 7233	Applicant

LICENSED PROFESSIONAL INFO

<u>Primary</u>	<u>License #</u>	<u>License Type</u>	<u>Licensed Prof</u>	<u>Business Name</u>	<u>Lawson #</u>
----------------	------------------	---------------------	----------------------	----------------------	-----------------



GUILFORD COUNTY RECEIPT

Planning & Development
400 West Market Street
Greensboro, NC 27402
336-641-3334 - Planning
336-641-3707 - Permitting

Environmental Health
400 West Market Street
Greensboro, NC 27402
336-641-7613

RECEIPT INFO

<u>Receipt #</u>	<u>Receipt Date</u>	<u>Payor</u>	<u>Payment Method</u>	<u>Check/CC #</u>	<u>Receipt Amount</u>
166544	05/16/2022	TAMMY GRAVLEY	Master Card		\$300.00

Cashier ID: JBAUMGA

<u>Fee Item Description</u>	<u>Account Code</u>	<u>Amount</u>
Residential Soil Evaluation	210545 45122	\$300.00
	Total	\$300.00

APPLICATION INFO

<u>Application #</u>	<u>Application Type</u>	<u>Application Name</u>
22-05-SNHR-03629	Building/Guilford County/Health Residential/Soil Evaluations New	

PROPERTY INFO

<u>Property Address</u>	<u>Property Owner</u>	<u>Parcel #</u>
7683 ANTHONY RD KERNERSVILLE, NC 27284	Marty & Tammy Gravley 7690 Anthony Rd Kernersville, Nc 27284	234178

CONTACT INFO

<u>Contact Name</u>	<u>Contact Type</u>
Gina Barnes 916 Van Buren Rd Eden, Nc 27288	Applicant

LICENSED PROFESSIONAL INFO

<u>Primary</u>	<u>License #</u>	<u>License Type</u>	<u>Licensed Prof</u>	<u>Business Name</u>	<u>Lawson #</u>
----------------	------------------	---------------------	----------------------	----------------------	-----------------